

HOW TO SPECIFY

EXTON LED IP65 4" SPA MONOPOINT SYSTEM WITH REMOTE POWER

STEP 1

- a. Pick an Exton 4" SPA Monopoint type
- b. Determine project quantity




Example:

- a. SPA 4" Monopoints with LV wire to Power Supply(s)
- b. Total Quantity: 10

STEP 2

Determine the number of Modules, between 1 and 10 (max) per 40W (max) Power Supply.

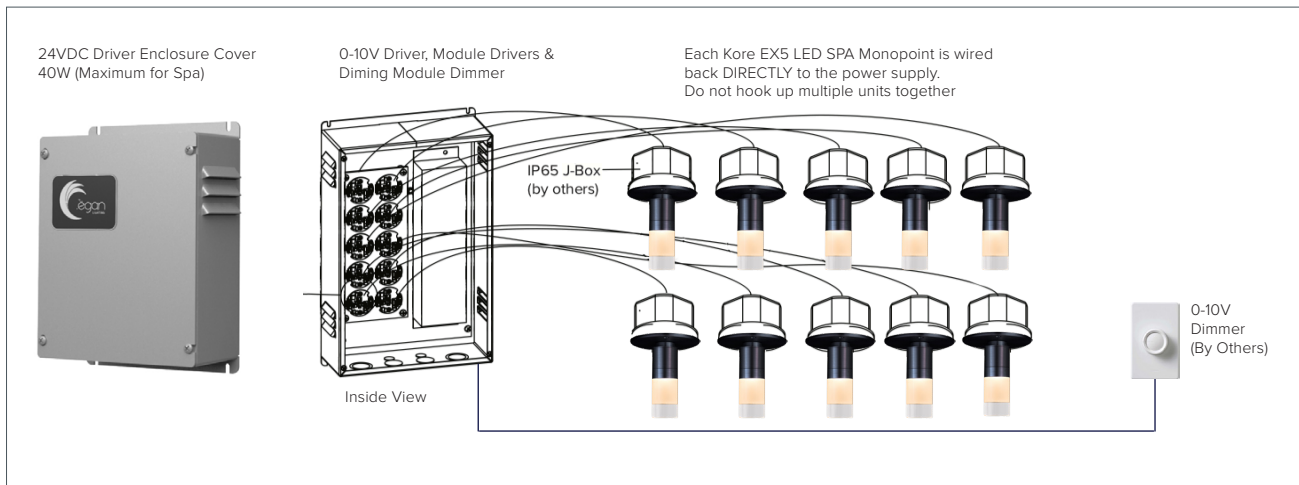

NOTES:

- Driver modules are removed at Tegan and placed in the remote Power Supply Enclosure to prevent overheating in a Spa environment.
- Refer to the manufacturers Power Supply specification sheet links for the maximum remote mount distance.
- Max 300W per circuit.